® **TECHNICKÝ A ZKUŠEBNÍ ÚSTAV STAVEBNÍ PRAHA, s.p.**
Technical and Test Institute for Construction Prague, SOE
Akreditovaná zkušební laboratoř, Autorizovaná osoba, Notifikovaná osoba, Oznámený subjekt, Subjekt pro technické posuzování, Certifikační orgán, Inspekční orgán • Accredited Testing Laboratory, Authorized Body, Notified Body, Technical Assessment Body, Certification Body, Inspection Body • Prosecká 811/76a, 190 00 Praha 9 - Prosek, Czech Republic

Branch 0300 – Pilsen

CERTIFICATE

No. 030 – 061904

About the qualities of a product

Certified quality: **SLIPPERINESS** according to the following test procedures:

DIN 51130	Testing of floor coverings determination of anti – slip properties; workrooms and fields of activities with raised slip langer, walking method – ramp test
PCEN/TS 16165	Determination of slip resistence of pedestrian surfaces – Methods of evaluation

Product: **Tactile paths inside – rubber (wheels, grooves)**
Producer: **Samostalna radnja DizajnBIRO, Rabrenovački put bb, 31330 PRIBOJ, Srbija**
Order: Z 030210222

Achieved values:

Testing of samples		DIN 51130, PCEN/TS 16165 (method B) classification	
Tactile paths inside - rubber	**wheels**	7,8°	R 9
Tactile paths inside - rubber	**grooves**	7,4°	R 9

The certificate is issued on the basis of the results of the tests stated in report no. 030–056039 from 28th November 2017.
The certificate is extended the period of validity based on the manufacturer's assertion that the manufacturing technology remains unchanged.
Number of pages of certificate: 1

Certificate validity: **till 30th June 2024**
The certificate can be cancelled upon finding non-adherence to the certified parameters of product qualities.

Pilsen 25th June 2021

Stamp of TZUS – branch Pilsen

Ing. Alexander Trinner
Branch Director

Warning: Without a written consent of the representative of the head of the authorised person, this report must not reproduced otherwise than in its entirety.

TECHNICKÝ A ZKUŠEBNÍ ÚSTAV STAVEBNÍ PRAHA, s.p.
Technical and Test Institute for Construction Prague
Akreditovaná zkušební laboratoř, Autorizovaná osoba, Notifikovaná osoba, Oznámený subjekt, Subjekt pro technické posuzování, Certifikační orgán, Inspekční orgán / Accredited Testing Laboratory, Authorised Body, Notified Body, Technical Assessment Body, Certification Body, Inspection Body. Prosecká 811/76a, 190 00 Praha 9
Central laboratory
Testing department Plzeň, Zahradní 15, 326 00 Plzeň
tel.: +420 377 430 345, e-mail: ruml@tzus.cz, www.tzus.eu
L 1018.3

TEST REPORT

issued by Testing Laboratory No. 1018.3
accredited pursuant to ČSN EN ISO/IEC 17025:2005 by Czech Accreditation Institute

No. 030 – 056039

from determination of anti-slip properties of tactile paths inside - rubber

Ordering Party:	**Samostalna radnja DizajnBIRO**
Address:	**Rabrenovački put bb, 31330 PRIBOJ, Srbija**
Company ID:	101207123
Manufacturer:	**Samostalna radnja DizajnBIRO**
Address:	**Rabrenovački put bb, 31330 PRIBOJ, Srbija**
Test sample:	**Tactile paths inside – rubber (wheels, grooves)**
Order No.:	Z030 17 0460

Number of pages of the Test Report incl. title page: 4 Pages of Annexes: -

Prepared by:

Ing. Hana Kotorová
specialist

Approved by:

Vít Ruml
head of the testing department

Print No.: 1
Number of prints: 3

razitko zkušební laboratoře č. 1018.3

Plzeň, on 28.11.2017

Declaration: **1) The test results in this Report relate only to the tested article and they do not substitute any other documents**
2) The Test Report must be copied as a whole only otherwise a written consent of the testing laboratory is needed.

1 Initial Data

1.1 Assignment

- Execution of tests of slipperiness of **tactile paths inside - rubber** according the requirement of the client:
  - **determination of slipperiness – walking methods – ramp test** (shoe method) according DIN 51130, PCEN/TS 16165 (method B)

1.2 Samples

- Sample specification: **Tactile paths inside – rubber (wheels, grooves)**
- Producer: **Samostalna radnja DizajnBIRO, Rabrenovački put bb, 31330 PRIBOJ, Srbija**
- Samples supplied on 16.11.2017.

2 Sampling Method

The test samples were supplied by the customers on 16.11.2017.
The samples were recorded this way:
Tactile paths inside - rubber wheels no. sample VZ 030171225

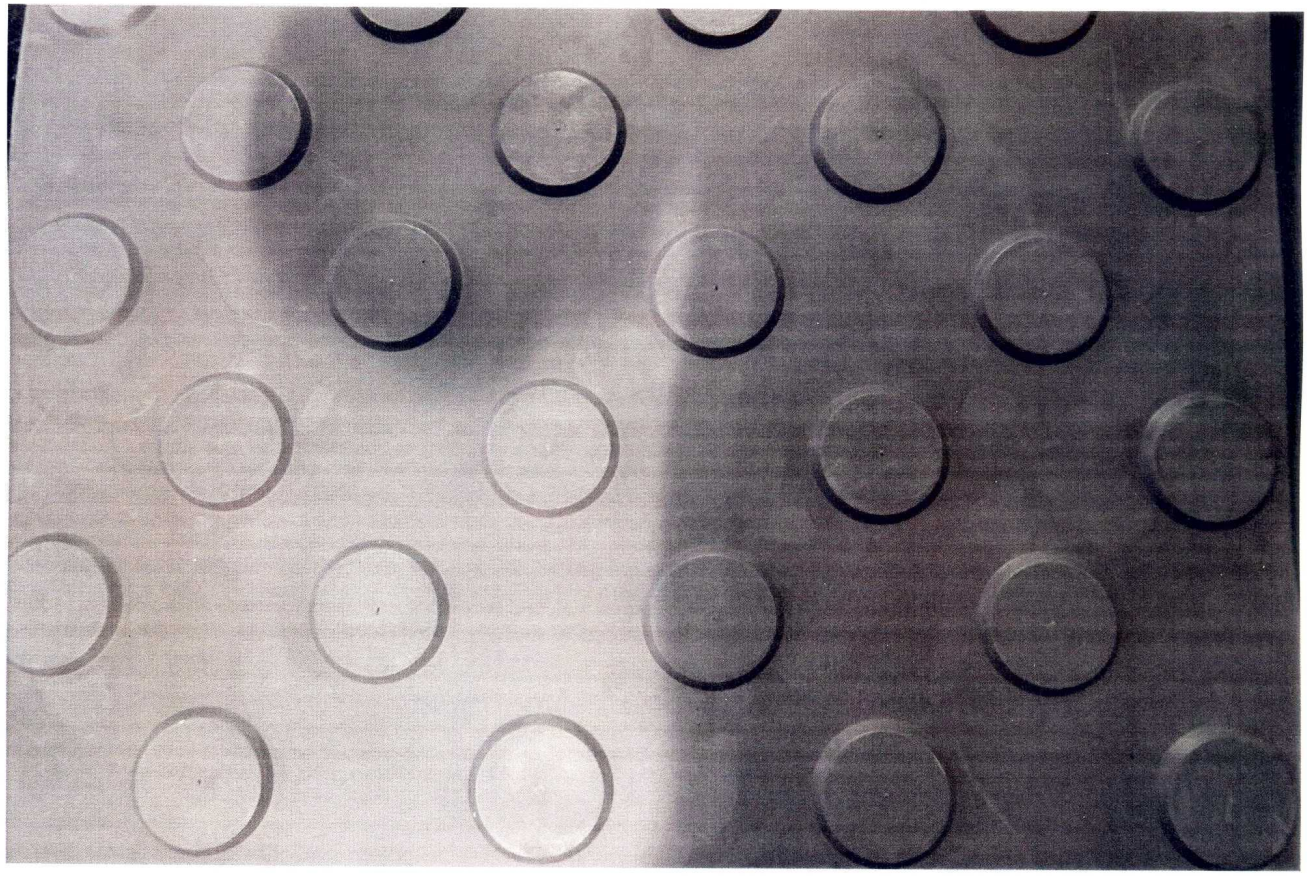

TECHNICKÝ A ZKUŠEBNÍ ÚSTAV STAVEBNÍ PRAHA, s.p.
Akred. zkuš. laboratoř č. 1018.3
TZÚS
Zkušebna Plzeň
Centrální laboratoř

Tactile paths inside - rubber grooves no. sample VZ 030171226

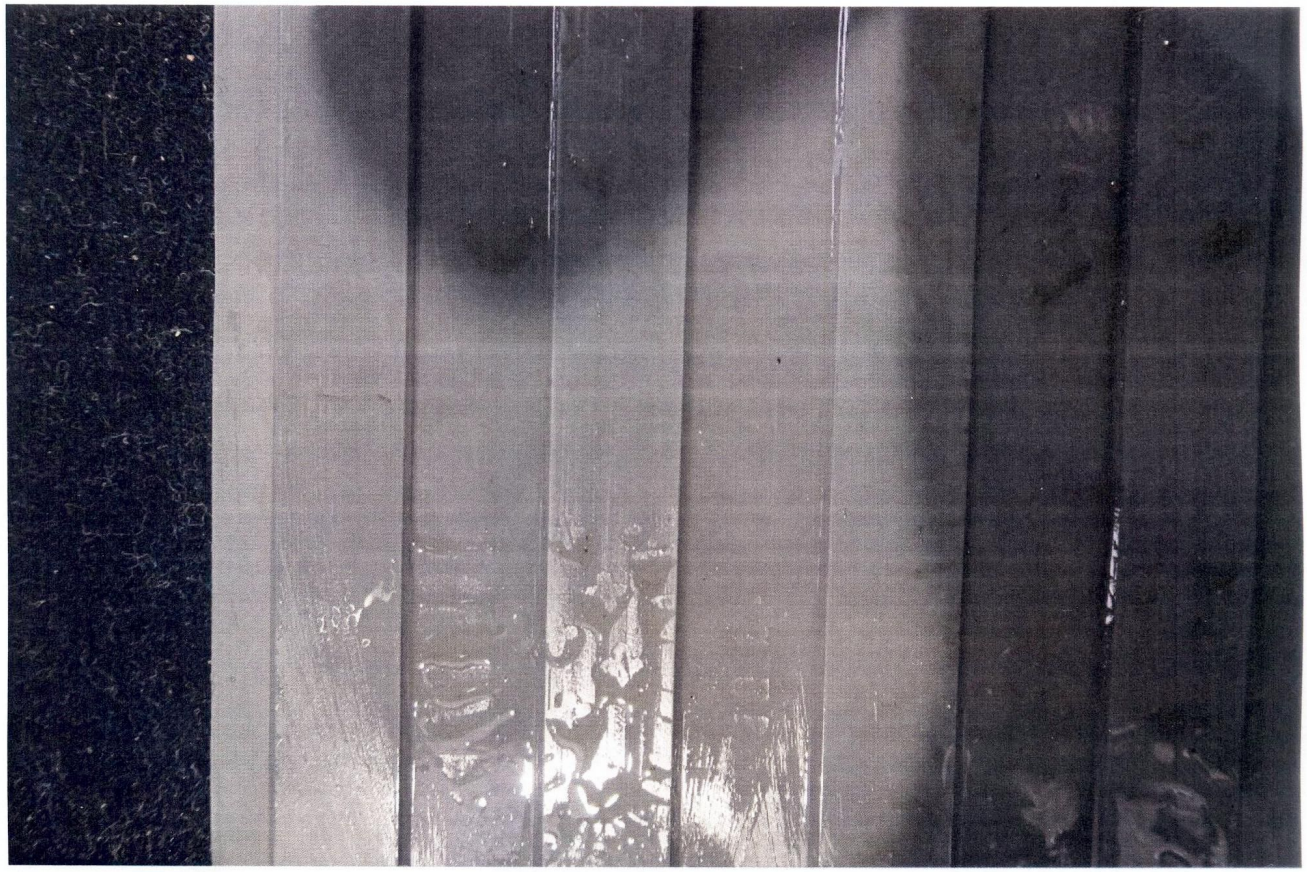

3 Testing Procedures

DIN 51130	Testing of floor coverings determination of anti – slip properties; workrooms and fields of activities with raised slip langer, walking method – ramp test
PCEN/TS 16165	Determination of slip resistence of pedestrian surfaces – Methods of evaluation

4 Measurements and Tests

Determination of slipperiness – walking methods – ramp DIN 51130

Testing of samples		DIN 51130, PCEN/TS 16165 (method B) classification
Tactile paths inside - rubber	**wheels**	7,8° R 9
Tactile paths inside - rubber	**grooves**	7,4° R 9

TECHNICKÝ A ZKUŠEBNÍ ÚSTAV STAVEBNÍ PRAHA, s.p.
Akred. zkuš. laboratoř č. 1018.3
TZÚS
Zkušebna Plzeň
Centrální laboratoř

4. Conclusion

Based on the results of the test **pursuant to DIN 51130, PCEN/TS 16165 (method B)** the tested samples of **Tactile paths inside – rubber (wheels, grooves)** produced in the **Samostalna radnja DizajnBIRO, Rabrenovački put bb, 31330 PRIBOJ, Srbija** classified **in class R9** and can be used for paving e.g. for paving in space for breaks, customer spaces, massage rooms, hairdressing salons, rooms for mangles, for ironing, classrooms etc.).

It should be pointed out that to ensure proper slip resistant function of flooring in the sense of stated conclusion, it is needed to maintain surface in clean conditions and without significant wear. Other properties were not subject to testing.

END OF REPORT

TECHNICKÝ A ZKUŠEBNÍ ÚSTAV STAVEBNÍ PRAHA, s.p.
Akred. zkuš. laboratoř č. 1018.3
TZÚS
Zkušebna Plzeň
Centrální laboratoř